

WATER REQUIREMENT



-FIELD ELEVATION
-WITHIN 30m OF FIELD
-DOWNSTREAM OF
BACKFLOW IS 431 l/min
@ 6.26 Bars

IRRIGATION LEGEND

- PRODUCT DESCRIPTION**
- HUNTER I-20-36S-XX/I-20-6P-36S-XX NOZZLE AS SHOWN
 - HUNTER I-20-ADS-XX/I-20-6P-ADS-XX NOZZLE AS SHOWN
- NOZZLE PERFORMANCE:**
- #3.5 @ 3.0 Bars - 12.0 l/min 11.3m RADIUS
 - #6 @ 3.0 Bars - 19.4 l/min 11.9m RADIUS
 - #8 @ 3.0 Bars - 24.0 l/min 13.1m RADIUS
 - #10 @ 3.0 Bars - 33.5 l/min 12.8m RADIUS
- ⊕ HUNTER IC/IBV ELECTRIC CONTROL VALVE SIZE AS SHOWN
 - ⊕ HUNTER HQ-44-XX-AW QUICK COUPLER VALVE (OPTIONAL)
 - ⊕ HUNTER IC-1200-M SOLID STATE METAL CABINET CONTROLLER
 - ⊕ HUNTER SOLAR-SYNC-SEN ON SITE WEATHER SENSOR
 - ⊕ WATER METER MINIMUM SIZE @ 431 l/min IS 63mm
- ⊕ BACKFLOW PREVENTER SIZED TO SYSTEM l/min
 - ⊕ MAINLINE PIPE
 - ⊕ LATERAL PIPE
 - ⊕ SLEEVING
 - ⊗ ISOLATION VALVE LINE SIZED

IRRIGATION NOTES

1. SPRINKLER LOCATIONS ARE TO SCALE
2. PIPE LOCATIONS ARE DIAGRAMMATIC
3. ALL SPRINKLERS TO BE INSTALLED ON 32mm SCH 80 SWING JOINTS
4. ALL COMPONENTS TO BE INSTALLED AS PER MANUFACTURERS RECOMMENDATIONS
5. MAINLINE DEPTH TO BE NO LESS THAN 460mm
6. LATERAL DEPTH TO BE NO LESS THAN 410mm
7. ELECTRIC CONTROL VALVES TO BE COVERED WITH 12" VALVE BOX
8. LOCATE VALVES/ICQV'S OUT OF HIGH TRAFFIC AREAS
9. WIRE SPLICE CONNECTIONS TO BE WATERPROOF
10. QCV TO BE LOCATED IN 10" VALVE BOX
11. ALL SLEEVES TO BE 2X PIPE RUN THROUGH THEM
12. INSTALL ALL COMPONENTS AS PER LOCAL, STATE, FEDERAL CODES
13. REFER TO HUNTER INSTALLATION DETAILS SPECIFICATIONS
14. REFER TO HUNTER CATALOG FOR PERFORMANCE SPECIFICATIONS
15. ADD HUNTER "FS" FOR DIRTY WATER VALVE
16. ADD HUNTER "AS" FOR PRESSURE REGULATED VALVE

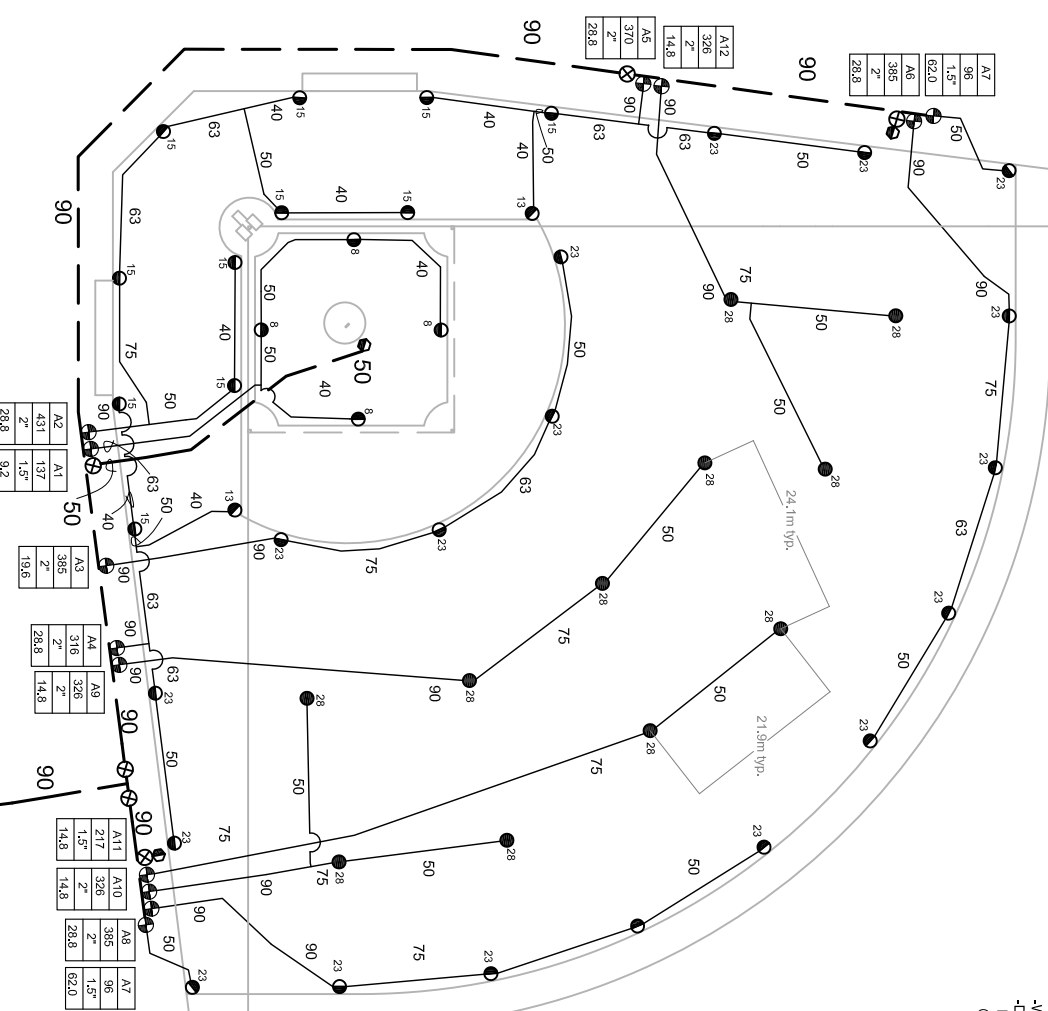


VALVE ID GUIDE

A1	STATION NUMBER
273	1.5" VALVE SIZE
19	PRECIPITATION RATE mm/hr

SYSTEM PERFORMANCE DATA

ZONE	SIZE	FLOW m ³ /hr	PR mm/hr	DU	SC ^(100% WATERS)
A1	1.5"	8.2	137	9.2	.83
A2	2"	25.9	431	14.4	.87
A3	2"	23.1	385	19.6	.82
A4	2"	19.0	316	28.8	.79
A5	2"	22.2	370	28.8	.79
A6	2"	23.1	385	28.8	.79
A7	2-1.5"	11.6	193	62.0	.79
A8	2"	23.1	385	28.8	.79
A9	2"	19.6	326	14.8	.77
A10	2"	19.6	326	14.8	.77
A11	1.5"	13.0	217	14.8	.77
A12	2"	19.6	326	14.8	.77



OFFICIAL BASEBALL FIELD
I-25 FOUR ROW DESIGN

Hunter Industries
1940 Diamond Street
San Marcos, California 92078
SpecPro Technical Assistance
1-800-319-4796
www.HunterIndustries.com

SHEET
1 OF 1

Hunter Industries offers this data as a general guide for estimating purposes and does not inherently warrant or represent that the data is accurate. The user is responsible for the design and installation of every system and of every site we recommend that a qualified irrigation designer be consulted.