

WATER REQUIREMENT

WATER REQUIREMENT AT
 -FIELD ELEVATION
 -WITHIN 30m OF FIELD
 -DOWNSTREAM OF BACKFLOW
 IS 363 l/min @ 5.96 Bars

IRRIGATION LEGEND

PRODUCT DESCRIPTION

- HUNTER I-40-04-SS-ON-B-XX/I-40-06-SS-ON-B-XX NOZZLE AS SHOWN
- HUNTER I-40-04-SS-B-XX/I-40-06-SS-B-XX NOZZLE AS SHOWN
- HUNTER I-40-04-SS-HS-B/I-40-06-SS-HS-B NOZZLE AS SHOWN


NOZZLE PERFORMANCE:

- #8 @ 5.0 Bars - 38.2 l/min 14.3m RADIUS
- #10 @ 5.5 Bars - 49.3 l/min 15.8m RADIUS
- #13 @ 5.5 Bars - 53.9 l/min 16.2m RADIUS
- #15 @ 5.5 Bars - 68.9 l/min 18.0m RADIUS
- #23 @ 5.5 Bars - 92.7 l/min 19.8m RADIUS
- #23ON @ 5.5 Bars - 90.8 l/min 20.4m RADIUS

- HUNTER ICV/IBV ELECTRIC CONTROL VALVE SIZE AS SHOWN
- HUNTER HQ-44-XX-AW QUICK COUPLER VALVE (OPTIONAL)
- HUNTER ACC-1800-M SOLID STATE METAL CABINET CONTROLLER
- HUNTER SOLAR-SYNC-SEN ON SITE WEATHER SENSOR
- WATER METER MINIMUM SIZE @ 363 l/min IS 63mm
- BACKFLOW PREVENTER SIZED TO SYSTEM l/min
- MAINLINE PIPE
- LATERAL PIPE
- SLEEVING
- ⊗ ISOLATION VALVE LINE SIZED
- ⊗ HUNTER FLOW SENSOR IN LINE SIZED FLOW CLIK TEE "FCT"

IRRIGATION NOTES

1. SPRINKLER LOCATIONS ARE TO SCALE
2. PIPE LOCATIONS ARE DIAGRAMMATIC
3. ALL SPRINKLERS TO BE INSTALLED ON 32mm SCH 80 SWING JOINTS
4. ALL COMPONENTS TO BE INSTALLED AS PER MANUFACTURERS RECOMMENDATIONS
5. MAINLINE DEPTH TO BE NO LESS THAN 460mm
6. LATERAL DEPTH TO BE NO LESS THAN 100mm
7. ELECTRIC CONTROL VALVES TO BE COVERED WITH 12" VALVE BOX
8. LOCATE VALVES/QCV'S OUT OF HIGH TRAFFIC AREAS
9. WIRE SPICE CONNECTIONS TO BE WATERPROOF
10. QCV TO BE LOCATED IN 10" VALVE BOX
11. ALL SLEEVES TO BE 2X PIPE RUN THROUGH THEM
12. INSTALL ALL COMPONENTS AS PER LOCAL, STATE, FEDERAL CODES
13. REFER TO HUNTER INSTALLATION DETAILS
14. REFER TO HUNTER CATALOG FOR PERFORMANCE SPECIFICATIONS
15. ADD HUNTER "FS" FOR DIRTY WATER VALVE
16. ADD HUNTER "AS" FOR PRESSURE REGULATED VALVE

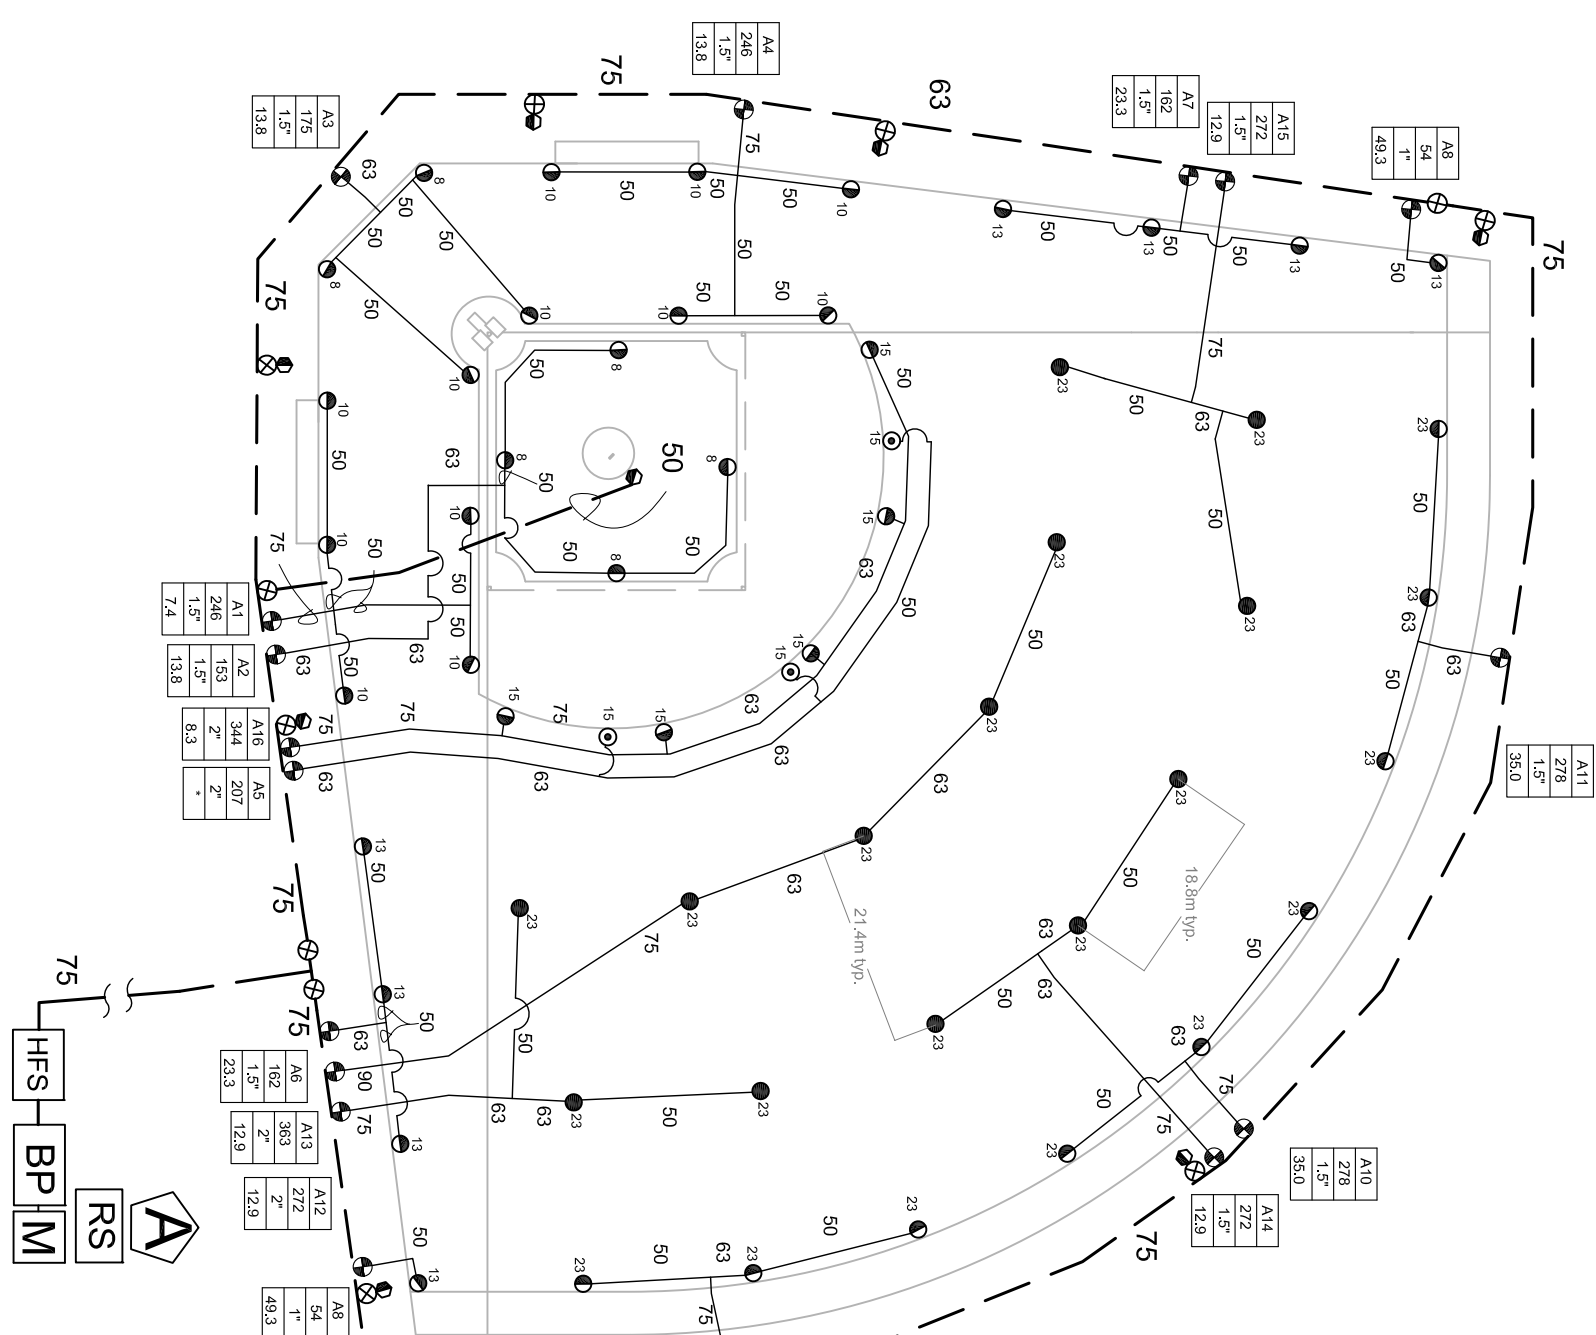

VALVE ID GUIDE

A1	STATION NUMBER
273	1.5" VALVE SIZE
190	PRECIPITATION RATE mm/hr


SYSTEM PERFORMANCE DATA

ZONE	SIZE	FLOW m ³ /hr	PR l/min	DU	SC _(10%) (WINDOW)
A1	1.5"	14.7	246	7.4	1.3
A2	1.5"	9.2	153	13.8	1.2
A3	1.5"	10.5	175	13.8	1.3
A4	1.5"	14.7	246	13.8	1.2
A5	2"	12.4	207	*	1.2
A6	1.5"	9.7	162	23.3	1.1
A7	1.5"	9.7	162	23.3	1.1
A8	2-1"	6.5	108	49.3	1.3
A9	1.5"	16.6	278	35.0	1.3
A10	1.5"	16.6	278	35.0	1.3
A11	1.5"	16.6	278	35.0	1.3
A12	1.5"	16.3	272	12.9	1.3
A13	2"	21.8	363	12.9	1.3
A14	1.5"	16.3	272	12.9	1.3
A15	1.5"	16.3	272	12.9	1.3
A16	1.5"	19.9	331	8.3	1.2

Hunter Industries offers this plan as a general guide for estimating purposes and offers no warranty, expressed or implied, for projects installed from this plan. Because of the many variables of every system and of every site we recommend that a qualified irrigation designer be consulted.

OFFICIAL BASEBALL FIELD

I-40 FOUR ROW DESIGN
 LOOPED MAINLINE

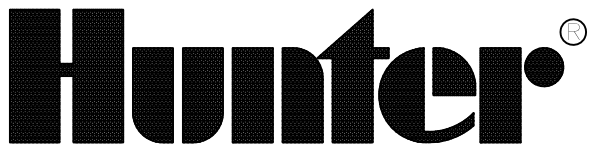

Hunter Industries
 1940 Diamond Street
 San Marcos, California 92078
 SpecPro Technical Assistance
 1-800-319-4796
 www.HunterIndustries.com

SHEET

1 OF 1